
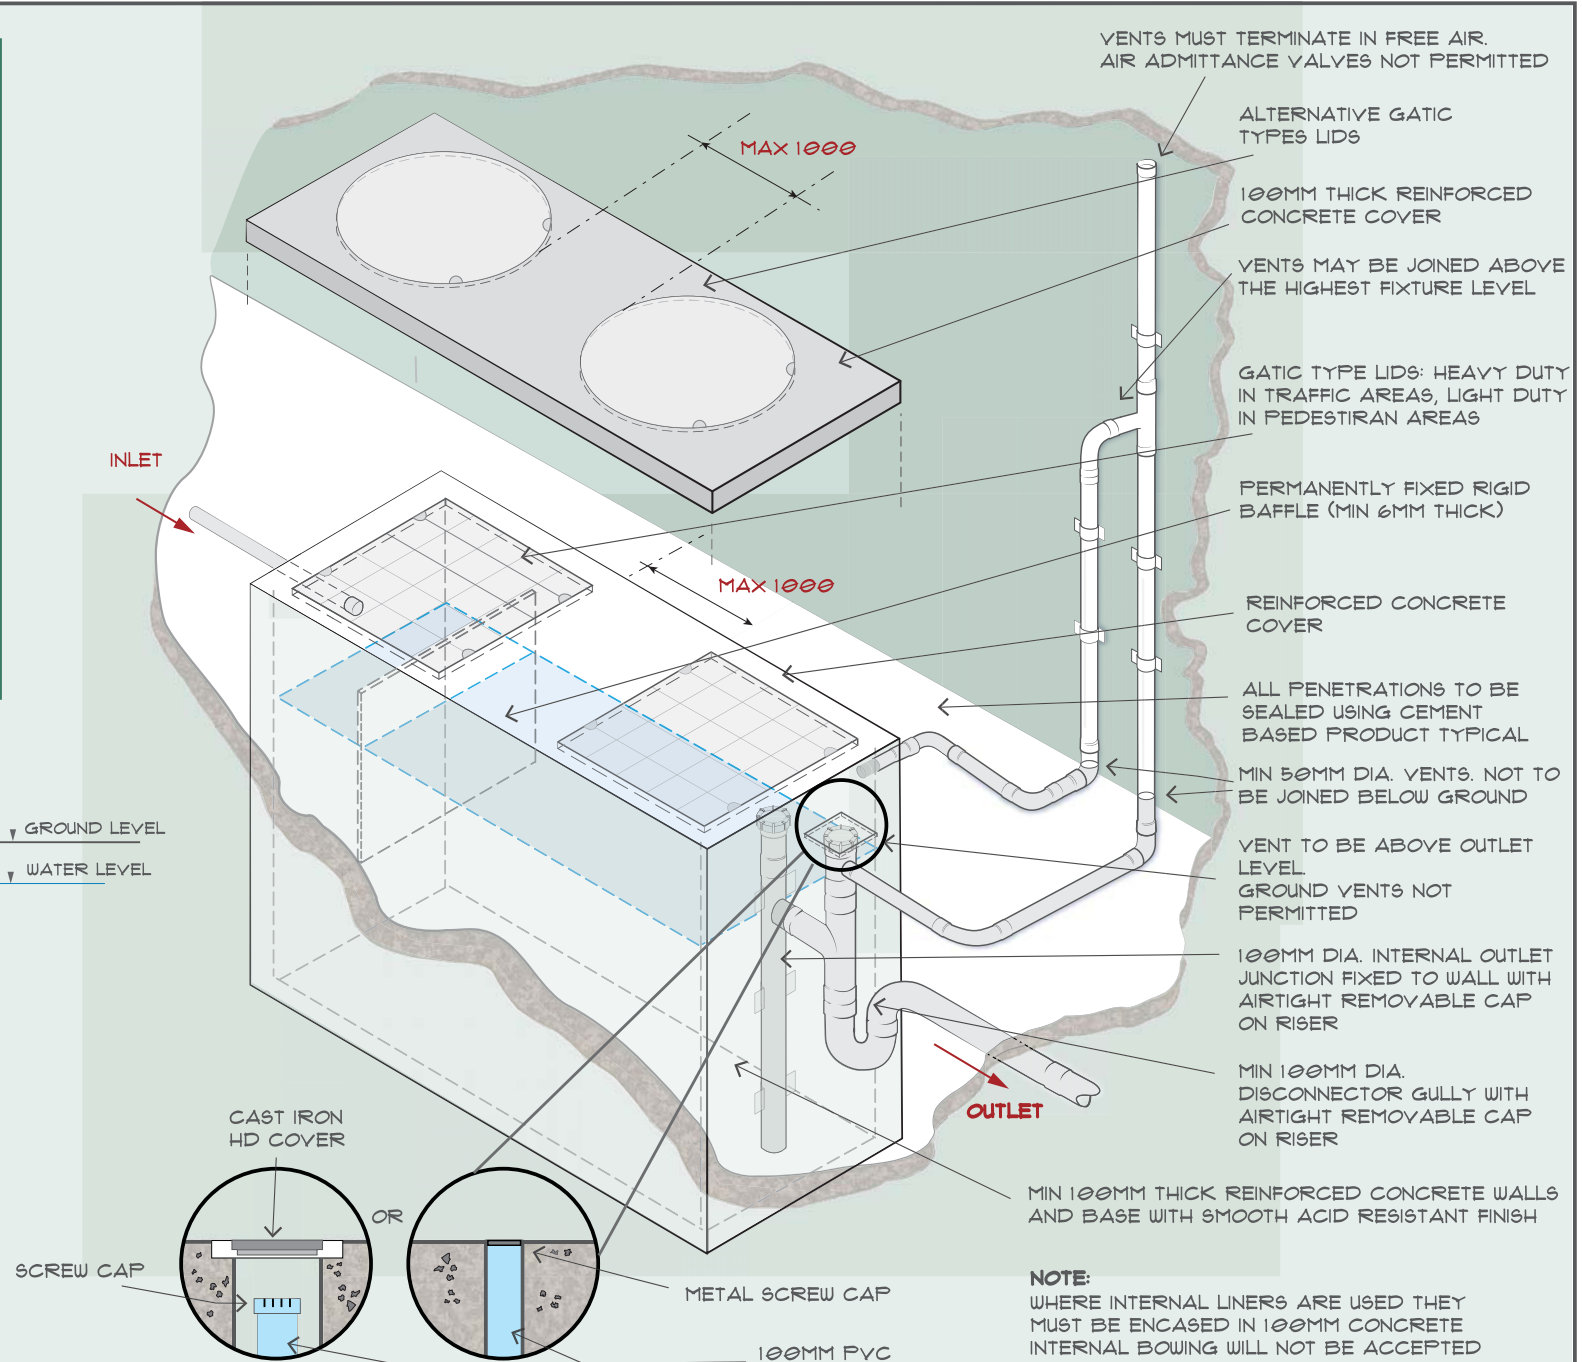


## STANDARDS (BELOW GROUND FOI)

- 1 TRADE WASTE CONSENT MUST BE OBTAINED FROM THE DEVELOPMENTAL DEPARTMENT BEFORE ANY WORK COMMENCES
- 2 THE FOI SHALL HAVE A MINIMUM WATER CAPACITY OF 1000 LITRES BELOW THE INVERT LEVEL OF THE OUTLET
- 3 THE RELEVANT HEALTH AUTHORITY MUST APPROVE THE LOCATION OF THE FOI PRIOR TO INSTALLATION. THE FOI IS NOT TO BE LOCATED WHERE THERE IS A LIKELIHOOD OF FOOD CONTAMINATION.
- 4 INSTALLATION TO BE IN ACCORDANCE WITH AS/NZS 3500.2 AND THE RELEVANT PLUMBING REGULATIONS
- 5 THE FOI MUST BE LOCATED TO ALLOW EASE OF ACCESS FOR INSPECTION AND MAINTENANCE
- 6 THE FOI SHALL NOT BE INSTALLED IN A CONFINED SPACE AS DEFINED BY THE WORKSAFE CODE OF VICTORIA
- 7 THE ENTIRE INTERNAL CHAMBER MUST BE ACCESSIBLE FOR MAINTENANCE PURPOSES
- 8 INCORRECTLY SIZED FOI'S WILL NOT BE ACCEPTED
- 9 FOI MUST BE INSTALLED BY A LICENSED PLUMBER AND A CERTIFICATE OF COMPLIANCE RECEIVED ON COMPLETION OF THE INSTALLATION
- 10 ALL WASH WATER GENERATING FIXTURES INCLUDING CLEANERS SINKS AND BIN WASHERS MUST BE CONNECTED TO THE FOI
- 11 ALL FOI'S INSTALLED MUST COMPLY WITH THIS STANDARD DRAWING OR AS OTHERWISE VARIED BY THE EXPRESS PERMISSION OF THE WATER AUTHORITY
- 12 NO ALTERNATIVES TO THIS APPARATUS ARE PERMITTED WITHOUT THE APPROVAL OF THE WATER AUTHORITY

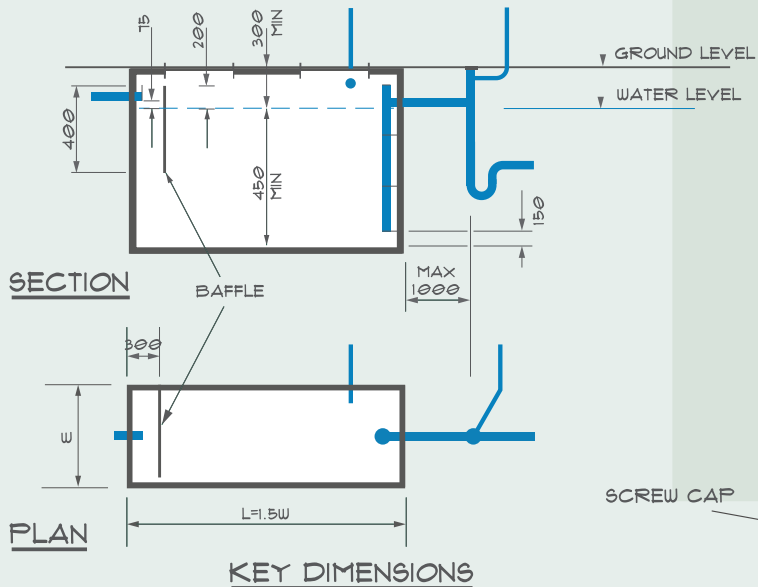

DRAWING NO:

REVISION

APPROVED BY  
WESTERNPORT WATER  
TRADE WASTE - DEVELOPMENT

SCALE  
NTS

DATE  
JULY 2015

# FOOD AND OIL INTERCEPTOR BELOW GROUND INSTALLATION

